
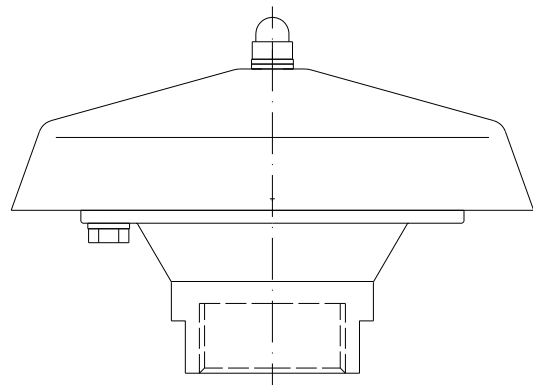


<b>End of Line Deflagration Flame Arrester</b>	: 1008-0008-75
<b>EC design test certificate no.</b>	: IBExU 09 ATEX 2022X
<b>Standard gap (MESG)</b>	: $\geq 0,50$ mm
<b>Explosion group</b>	:  G IIB
<b>Operating direction</b>	:
<b>Thread connection</b>	: G 1 1/4" innen/internal ISO228-1
<b>Weight</b>	: ~ 1,65 kg

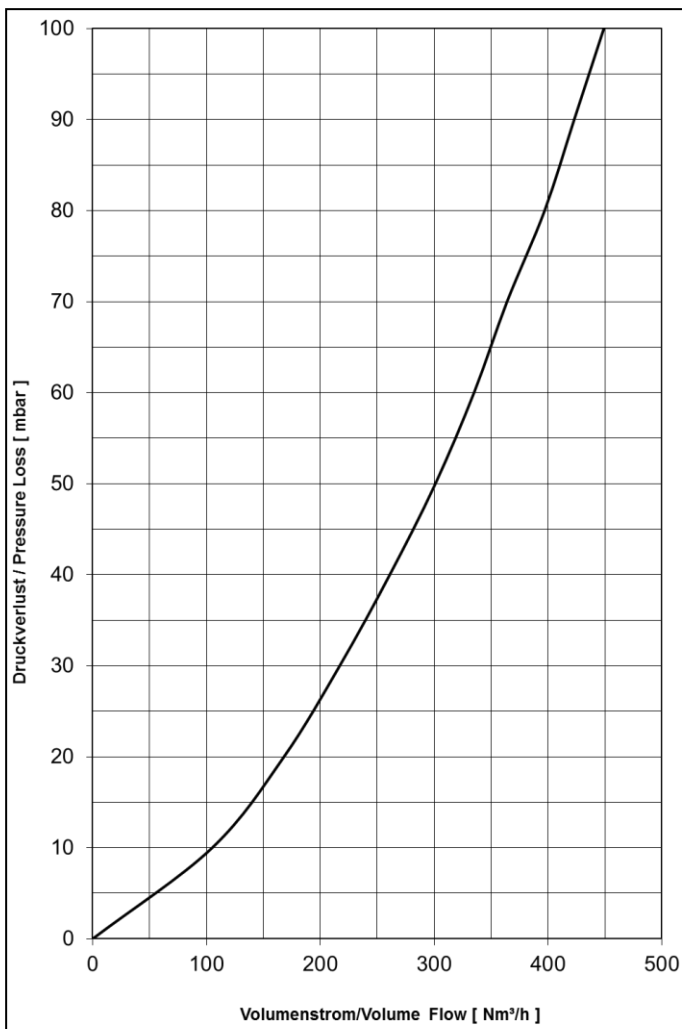

**Material**

Housing

V4A/AISI 316 range

Flame Arrester Element

1.4571 / AISI 316 Ti

**Operating Data**

Type	: DEF
Absolute pressure	: $\leq 1,1$ bar
Temperature	: $\leq 60,0$ °C
Nominal pipe size	: $\leq$ DN32

**Pressure loss**

**Medium Air**

$p_0 = 1013$  mbar,  $T_0 = 273K$ , density =  $1,293$  kg/m<sup>3</sup>